

GENERAL DESCRIPTION

The isolated converter DAT 4531 B is able to measure and linearise the standard RTDs and resistances with 2 or 3 wires cable compensation. In function of programming, the measured values are converted in a current or voltage signal. The device guarantees high accuracy and performances stability both versus time and temperature.

The programming is made by the dip-switch located in the window on the side of the enclosure. By means of dip-switches it is possible to select the input type and range and the output type without recalibrate the device.

Moreover, by Personal Computer the user can program all of the device's parameters for his own necessity. For all the sensors it is possible to set the cable compensation with 2 or 3 wires.

Moreover it is available the option of alarm for signal interruption (burn-out) that allows to set the output value as high or low out of scale

The 1500 Vac galvanic isolation on all ways (input, output and power supply) eliminates the effects of all ground loops eventually existing and allows the use of the converter in heavy environmental conditions found in industrial applications.

The DAT 4531 B is in compliance with the Directive 2004/108/EC on the Electromagnetic Compatibility.

It is housed in a plastic enclosure of 12.5 mm thickness suitable for DIN rail mounting in compliance with EN-50022 and EN-50035 standards.

USER INSTRUCTIONS

The converter must be powered by a direct voltage applied to the terminals Q and R.

The input channel measures the value from the sensor connected to the terminals I, L and G and transmits the output measure on the terminals N and M. The input and output connections must be made as shown in the section "Connections".

It is possible to configure the converter on field by dip-switch or Personal Computer as shown in the section "Programming". The configuration by dip-switches can be made also if the device is powered (note: after the configuration the device takes some seconds to provide the right output measure).

TECHNICAL SPECIFICATIONS (Typical at 25 °C and in nominal conditions)

INPUT				ОИТРИТ				POWER SUPPLY		
Input type	Min	Max	Min.Span	Output type Min		Max	Min Span	Power supply voltage	18 30 Vdc 60 Vdc max	
RTD (2, 3 wires) Pt100 Pt1000	-200°C -85°C	850°C 185°C	50°C 30°C	Current 0 mA Voltage 0 V		20 mA 10 V	4 mA 1 V	Reverse polarity protection Current consumption Current output	35 mA max.	
Ni100 Ni1000	-60°C -60°C	180°C 150°C	50°C 30°C	Output calibration Current ± 7 u				Voltage output	20 mA max.	
RES. (2, 3 wires)	0 Ω 0 Ω	$500~\Omega \\ 2000~\Omega$	50 Ω 50 Ω	Voltage ± 5 mV Burn-out values				ISOLATION Among all ways	1500 Vac, 50 Hz, 1 min	
Input Calibration (1) RTD the higher of ±0.1% and ±0.2°C Low Res. the higher of ±0.1% and ±0.15 Ω							TEMPERATURE AND HUMIDITY Operative temperature			
High Res.	the higher of $\pm 0.2\%$ and ± 1.0			Current output $< 500 Ω$ Voltage output $> 10 ΚΩ$ Short circuit current $26 mA max$				Humidity (not condensed) 0 90 %		
Linearity (1) RTD	± 0.1 %	f.s.		Response time (10÷ 90%) about 500 ms				Material Self-extinguishing plastic Mounting DIN rail in compliance with EN-50022 and		
Sensor excitation current RTD,Res 500 uA			(,			With EN- EN-5003 Weight about 90	35		
Line resistance RTD 3 wires	(,	x balanced)					EMC (for industrial enviro	nments) EN 61000-6-2	
Thermal drift (1) Full scale	± 0.01%	`	ix balaficeu)					Emission	EN 61000-6-4	
(1)referred to the input Span (difference between max. and min.)										

PROGRAMMING

CONFIGURATION BY PC

By software DATESOFT it is possible to:

- set the default programming of the device:
- program the options not available with the dip-switch; (burn-out level, etc...);
- read, in real time, the input and output measures;
- follow the dip-switches configuration wizard.

To configure the device follow the next steps:

- 1) Power-on the device.
- 2) Open the protection plastic label on the front of the device.
- 3) Connect the interface PRODAT to the PC (COM port) and to the device (PGRM connector).
- 4) Open DATESOFT.
- 5) Select the COM port in use.
- 6) Click on "Open COM".
- 7) Click on "Program".
- 8) Set the programming data.
- 9) Click on "Write" to send the programming data to the device.

PRODAT

POWER SUPPLY
UNIT

V+ V
COM PORT

TX/RX CABLE

Plastic label protection


PGRM

PGRM


PC.

Warning: during these operations the device must always be powered and the TX/RX cable always connected. For information about DATESOFT refer to the software's user guide.

CONFIGURATION BY DIP-SWITCHES

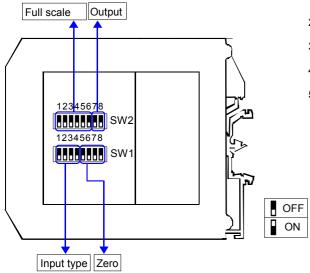


- 1) Open the suitable door on the side of the device.
- 2) Set the input type by the dip-switch SW1 [1..4] (see TAB.1)
- 3) Set the minimum input scale value (Zero) by the dip-switch SW1 [5..8] (see TAB.3)
- 4) Set the maximum input value (Full scale) by the dip-switch SW2 [1..6] (see TAB.3)
- 5) Set the output type by the dip-switch SW2 [7..8] (see TAB.2)

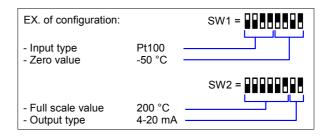


NOTE:

- It is also possible to set the dip-switches using the wizard of the configuration software following the procedure described in the section "Configuration by PC" until the step 6 and clicking on "Switch".

DIP-SWITCH CONFIGURATION TABLES





NOTES:

- * For all the input type selected by dip-switches, the compensation of wires is fixed at 3.
- * To configure the range for the input type selected (TAB.1) refer to the section of the TAB.3 on next page relative to it (ex: for Pt100 use the table TAB.3c).
- * If the dip-switches SW1 [1..4] are all set in the position 0 ("EPROM"), the device will follow the configuration programmed by PC (input type and range, output type and range and options).
- * If the dip-switches SW1 [5..8] are all set in the position 0 ("Default"), the device will follow the input scale programmed by PC for the input type selected by the dip-switches SW1 [1..4]
- * Eventual wrong dip-switches settings will be signalled by the blinking of the led "PWR".

TAB.3a – Settings for Resistance < 2KOhm

Zero		Full sca	le						
SW1		SW2	_	SW2		SW2		SW2	
5678	Ω Default	123456	Ω Default	123456	Ω 800	123456	Ω 1150	123456	Ω 1600
	0		500		820		1175		1650
	150		520		840		1200		1700
	200		540		860		1225		1750
	250		560		880		1250		1800
	300		580		900		1275		1850
	350		600		920		1300		1900
	400		620		940		1325		1950
	450		640		960		1350		2000
	500		660		980		1375		2000
	550		680		1000		1400		2000
	600		700		1025		1425		2000
	650		720		1050		1450		2000
	700		740		1075		1475		2000
	750		760		1100		1500		2000
	800		780		1125		1550		2000

TAB.3b – Settings for Resistance < 500 ohm

TAD.30 -	Settings	for Resistal	106 > 300	U UHHH						
Zero		Full scale								
SW1		SW2		SW2		SW2		SW2		
5678	Ω	123456	Ω	123456	Ω	123456	Ω	123456	Ω	
	Default		Default		125		210		370	
	0		50		130		220		380	
	10		55		135		230		390	
	20		60		140		240		400	
	30		65		145		250		410	
	40		70		150		260		420	
	50		75		155		270		430	
	75		80		160		280		440	
	100		85		165		290		450	
	125		90		170		300		460	
	150		95		175		310		470	
	175		100		180		320		480	
	200		105		185		330		490	
	225		110		190		340		500	
	250		115		195		350		500	
	300		120		200		360		500	

TAB.3c – Settings for Pt100, Pt1K, Ni100, Ni1K

FAB.3c – Settings for Pt100, Pt1K, Ni100, Ni1K									
Zero		Full sca	le						
SW1 5 6 7 8	°C	SW2 1 2 3 4 5 6	°C	SW2 1 2 3 4 5 6	°C	SW2 1 2 3 4 5 6	°C	SW2 123456	°C
	Default		Default		75		210		370
	-200		0		80		220		380
	-150		5		85		230		390
	-100		10		90		240		400
	-50		15		95		250		425
	-40		20		100		260		450
	-30		25		110		270		475
	-20		30		120		280		500
	-10		35		130		290		525
	0		40		140		300		550
	5		45		150		310		600
	10		50		160		320		650
	20		55		170		330		700
	30		60		180		340		750
	50		65		190		350		800
	100		70		200		360		850

INSTALLATION INSTRUCTIONS

The device is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following cases:

- If panel temperature exceeds 45°C
- Use of high power supply value (> 27 Vdc).
- Use of output current.

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.


Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.


ISOLATION STRUCTURE



CONNECTIONS

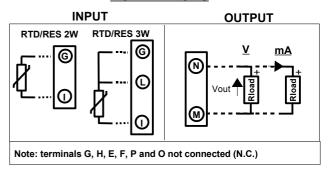

POWER SUPPLY



LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION		
PWR	GREEN	ON	Device powered		
		OFF	Device not powered		
		BLINKING	Wrong dip-switches setting		

DIMENSIONS (mm)

